



SECTION A-A

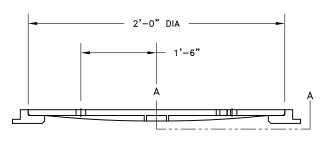



TOP OF MANHOLE IN UNIMPROVED AREA

NOTE 1: MANHOLE LIDS TO BE MADE FROM CAST IRON AND CONFORM WITH ASTM A-48 CLASS 35B.

NOTE 2: MANHOLE MUST WEIGH A MINNIMUM OF 260 LBS.

NOTE 3: MANHOLE COVER AND RING SHALL BE LOCKING TYPE CAPABLE OF WITHSTANDING $H\!-\!20$ High Loading.

NOTE 4: FOR MANHOLES IN UNPAVED AREAS USE OF A PAM MANHOLE COVER IS REQUIRED.

CRESCENTA VALLEY WATER DISTRICT			
SCALE: NTS		DATE: 03/14/2008	
DRAWN BY: B. YARED	STANDARD RING AND COVER	JOB NO.	DWG NO.
APP'VD BY: D. GOULD		_	22 - S