


CVWD WATER BONDS

Building Water Reliability



February 18, 2021

Subject: **Notice of Construction** – 8-inch Water Main Replacement on the 4800 block of Dyer Ave., 2800 block of El Caminito St., 4800 block of Glenwood Ave., 2800 block of Stevens St. and 6-inch water main on the 2700 block of Paraiso Way, Project E-1022.

Dear Resident:

Crescenta Valley Water District (CVWD) has awarded a construction contract to Brkich Construction of Monrovia, to replace the existing old water mains with new 8-inch and 6-inch diameter water mains on the 4800 block of Dyer Ave., 2800 block of El Caminito St., 4800 block of Glenwood Ave., 2800 block of Stevens St. and 6-inch water main on the 2700 block of Paraiso Way. This is part of CVWD's ongoing pipeline upgrade program (see project location map on reverse side).

Construction is scheduled to begin Monday, March 15, 2021. The contractor will start work at the intersection of Glenwood Ave and El Caminito Ave., and then proceed east on El Caminito Ave. towards Dyer Ave. Please visit CVWD's website at www.cvwd.com for updates on the construction schedule. We anticipate the entire pipeline replacement project will be completed in early June 2021.

Please note that there will be a period of time, usually between 6 to 8 hours, when the water service to your home will be shut down. This will occur on the days the contractor ties the new water main into the existing water main. CVWD will notify each resident, a minimum of 48 hours before the actual shutdown, with a door hanger that indicates the date and time.


We will be hosting a community meeting on March 11, 2021 to discuss the project and address any questions you may have regarding the work. We will send out a reminder letter and post a notification on our website announcing the time and location for the community meeting.

The contractor will also be installing temporary parking and traffic restrictions along El Caminito Ave., Glenwood Ave., Dyer Ave., Stevens Ave. and Paraiso Way. This will allow the contractor's crews to work in a safe and expeditious manner to complete the project. Temporary "No Parking" signs will be posted a minimum of two (2) days before construction. CVWD requests that you observe these signs and any other traffic control. Driveways within the work area may be temporarily restricted due to the construction. CVWD's on-site inspector and the contractor will assist you with access into and out of your driveway.

As in most construction projects, the work will create a certain amount of unavoidable public inconvenience. Your cooperation in making this project successful will be greatly appreciated.

If you have any questions or comments concerning this project, please contact Christina Olmedo at (818) 236-4115 or e-mail me at colmedo@cvwd.com.

Very truly yours,
CRESCENTA VALLEY WATER DISTRICT



Christina Olmedo
Assistant Engineer

cc: Nemesciano Ochoa – CVWD
Hooma Abarkohanai – City of Glendale Public Works
Dennis Maxwell – CVWD
Brook Yared – CVWD


G:\Engineering\E-Jobs OPEN\E-1021 - 8-inch Water Main - 3400 - 3500 Encinal\Notification\E-1021 Notification Letter 2 Bond.docx



2700 Foothill Blvd., La Crescenta, CA 91214

(818) 248-3925

www.CVWD.com

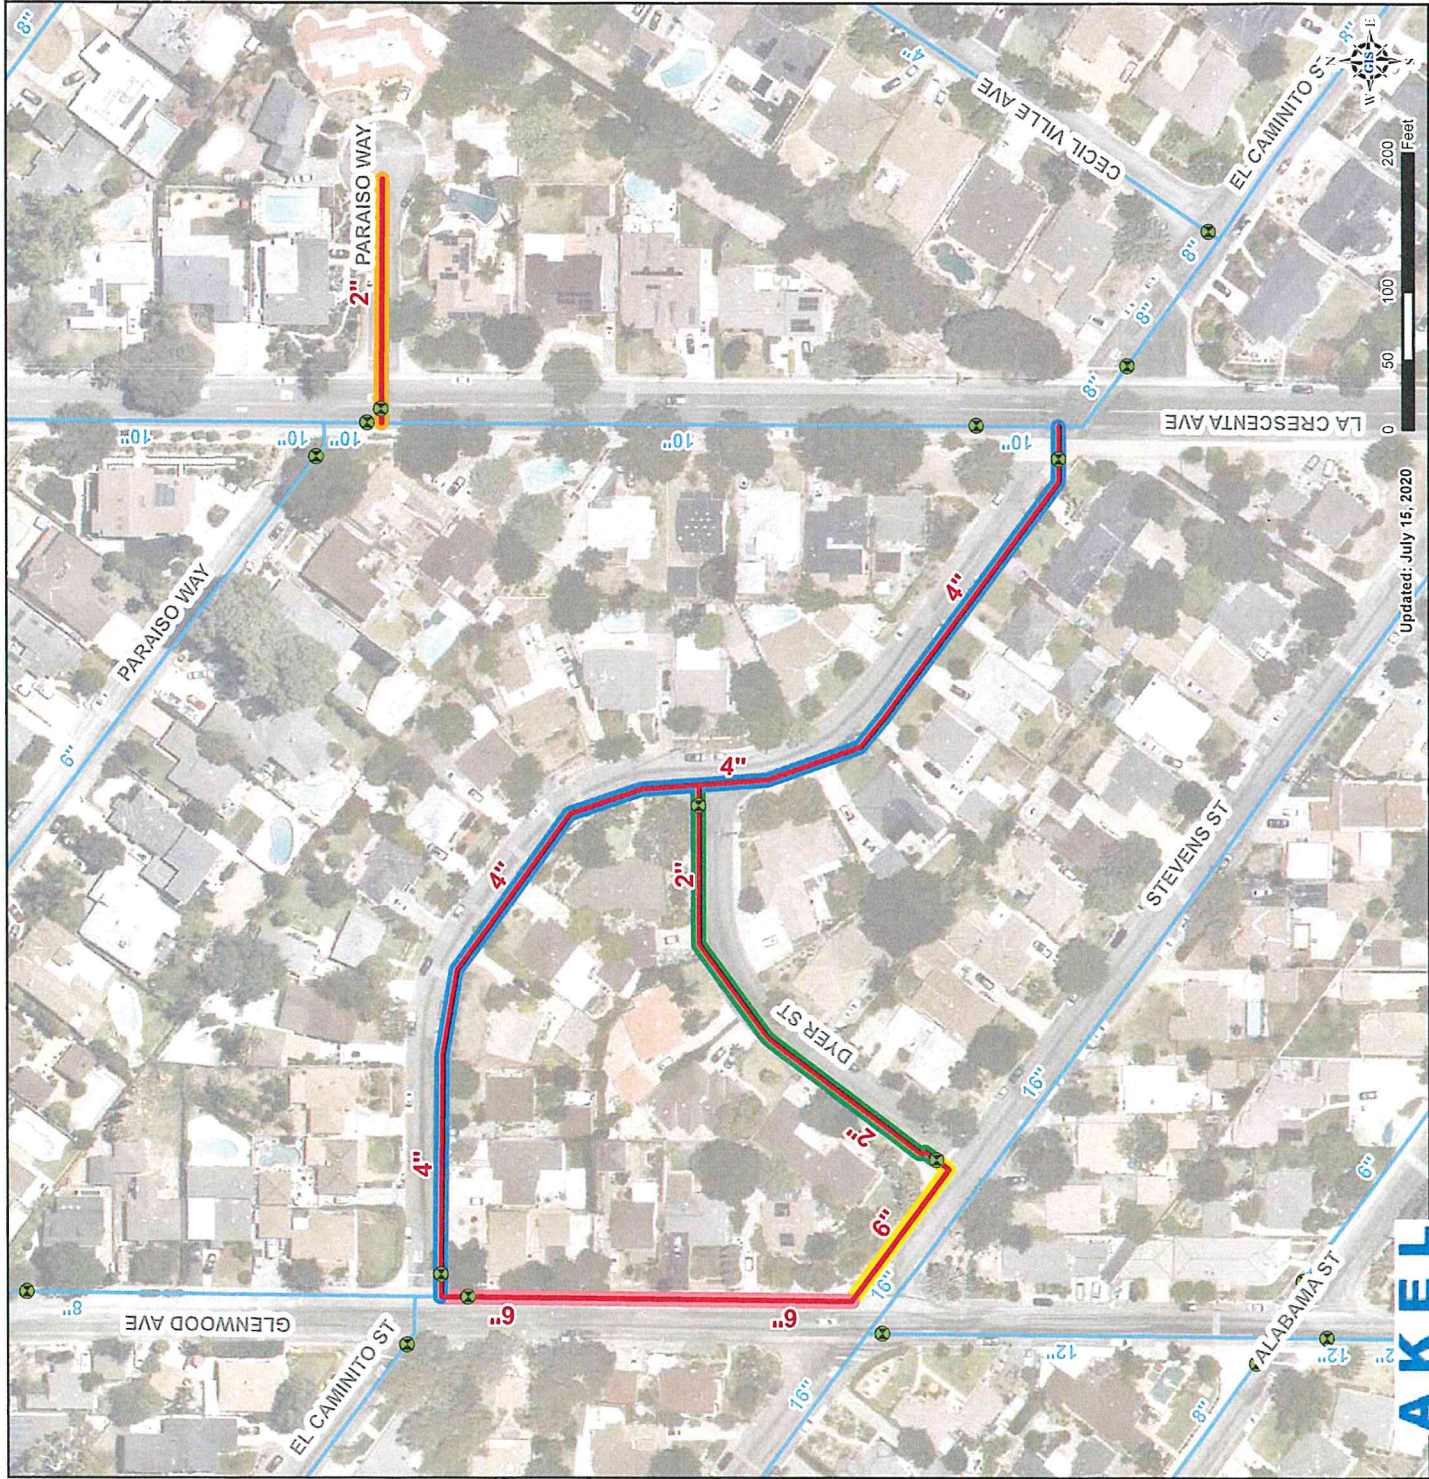

Legend

Pipeline to Replace

Replacement Segment ID

ID: Length, Year Inst., Material

135: 360ft, 1946, STD

142: 880ft, 1946, STD

240: 300ft, 1960, CL&W

521: 180ft, 1946, STD

729: 130ft, 1958, CL&W

Existing System

Tanks

Pump Stations

Wells

Valves

Active Mains

Project 4 Replacement
Total Length: 1,840 ft

PRELIMINARY

Year 1 - FY 20/21

Project 4

Pipeline Replacement

Schedule

Crescenta Valley Water District

