





1" VENT HOLES
TWO PLACES
180° APART

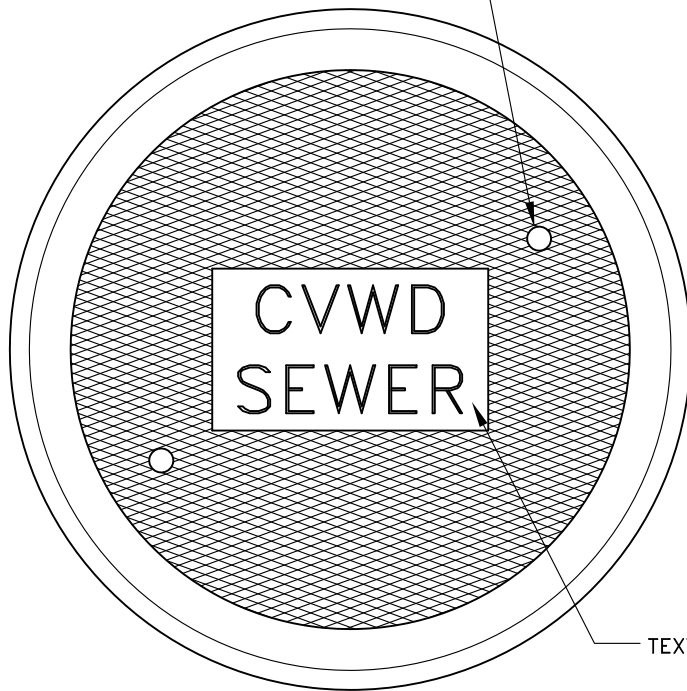

TEXT 3" HIGH

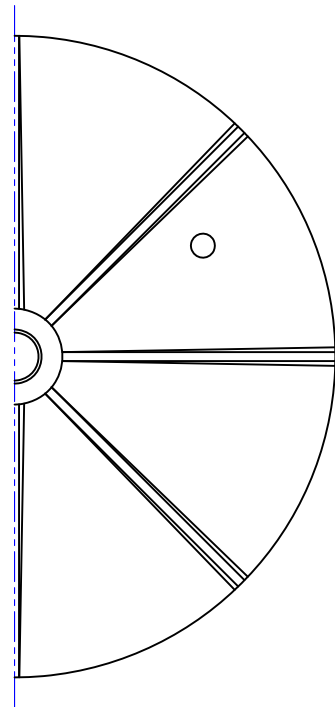

SECTION A-A

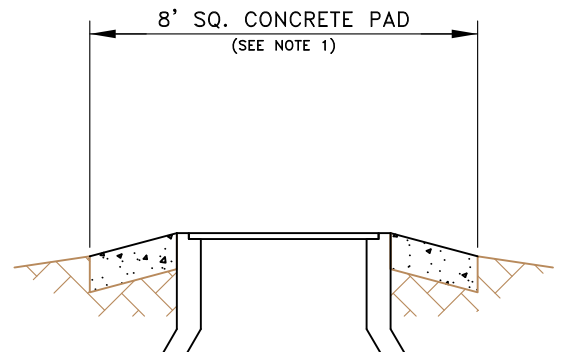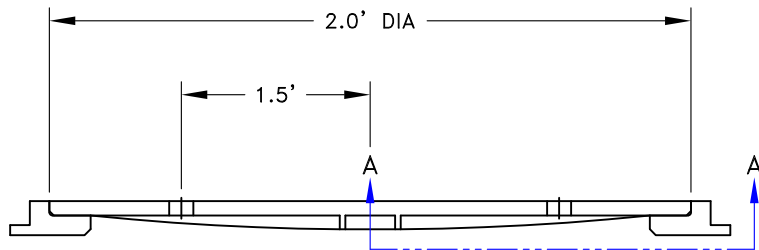

TOP OF MANHOLE IN
UNIMPROVED AREA

NOTE 1: MANHOLE LIDS TO BE
MADE FROM CAST IRON

NOTE 2: MANHOLE MUST WEIGH
A MINIMUM OF 260 LBS

NOTE 3: MANHOLE COVER AND
RING SHALL BE LOCKING TYPE
CAPABLE OF WITHSTANDING
H-20 HIGH LOADING.

NOTE 4: FOR MANHOLES IN
UNPAVED AREAS USE OF A PAM
MANHOLE COVER IS REQUIRED.

CRESCENTA VALLEY WATER DISTRICT



SCALE: NTS

DRAWN BY: B. YARED

APP'VD BY: D. GOULD

STANDARD RING AND COVER

DATE: 03/14/2008

JOB NO.

-

DWG NO.

22-S